

CALPEX PUR-KING

The revolutionary insulating foam for heating and cooling systems
with incomparably low loss of heat

Magic threshold exceeded
 λ_{50} 0.0199 W/mK



The energy-saving world champion with the lowest lambda value

CALPEX has set a new standard for heat insulation with a previously unachieved lambda value of 0.0199 W/mK. The benefit to you: greater energy efficiency, fewer operating costs and faster amortisation. CALPEX PUR-KING represents a breakthrough.



Sample calculation for the local heating network in an estate with single family homes and apartment buildings

Total	Length (m)	Pipe dimension (mm)	Heat loss PUR systems $\lambda_{50}: 0.0230 \text{ W/mK}$	Heat loss CALPEX PUR-KING $\lambda_{50}: 0.0199 \text{ W/mK}$	Difference
	112	32/76	9.16 W/m	7.92 W/m	
	106	40/91	9.59 W/m	8.27 W/m	
	178	50/111	9.84 W/m	8.51 W/m	
	436	63/126	11.20 W/m	9.71 W/m	
	86	75/142	12.06 W/m	10.48 W/m	
Total	918		9.71 kW	8.42 kW	1.30 kW

Calculation of the heat quantity and CO ₂ equivalent					
3500 h/a			34 000 kWh	29 457 kWh	4543 kWh
30 J			1020 MWh	884 MWh	136 MWh
CO ₂					30.6 t



CALPEX PUR-KING was inspected by IMA Dresden in April 2017 and certified by the German Accreditation Body.


Download: www.pipesystems.com

A milestone in the development of heat insulation


The all-time low heat insulation value achieved by CALPEX PUR-KING is based on the use of a newly developed technology for the manufacture of high pressure foaming. This technology was developed ready for production in 2 years and is setting new standards. It makes a significant contribution towards operating heating network systems in an even more economical and environmentally-friendly manner.



Continual research and development are paying off
CALPEX lambda values falling since 2001

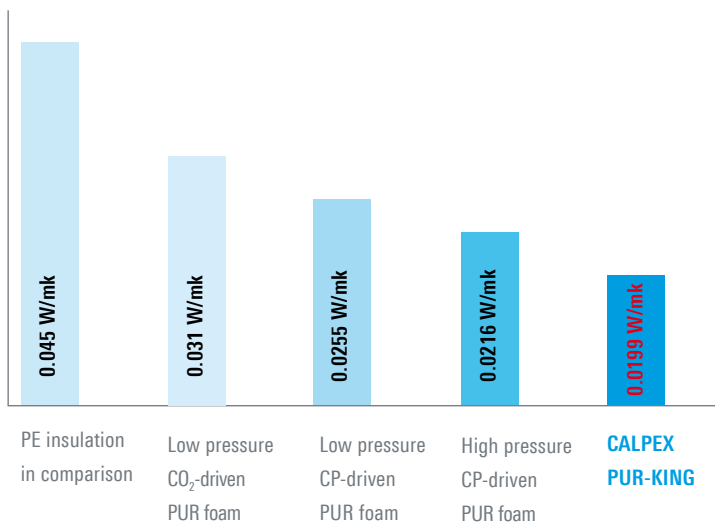

A size comparison with the new CALPEX PUR-KING
PE insulations vs. CALPEX PUR-KING

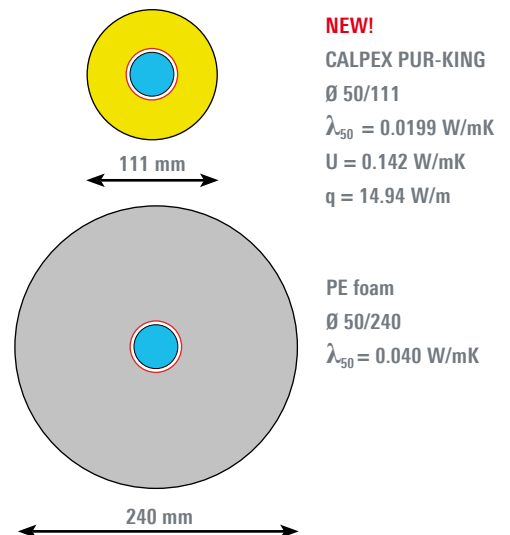

The CALPEX range with PUR-KING from April 2018:

CALPEX-UNO heating	CALPEX-DUO heating
25/76 + 25/91 PLUS	25+25/91 + 25+25/111 PLUS
32/76 + 32/91 PLUS	32+32/111 + 32+32/126 PLUS
40/91 + 40/111 PLUS	40+40/126 + 40+40/142 PLUS
50/111 + 50/126 PLUS	
63/126 + 63/142 PLUS	
75/142	



PE insulations of 240 mm
would be required to achieve the
same efficiency as CALPEX PUR-KING

All other sizes should be available for delivery from autumn 2018.

1 Task Definition

Brugg Rohrsysteme AG commissioned IMA Materialforschung und Anwendungstechnik GmbH with conducting tests on a preinsulated flexible pipe DN50, Ø 63/126 mm, type CALPEX NBA-PUR, pipe NBA 09.B in accordance with DIN EN 15632 and DIN EN 253 to the characteristics

- closed cell content,
- foam density,
- water absorption,
- thermal conductivity (unaged condition).

2 Requirements and standards

DIN EN 15632-2:2015-03

District heating pipes - Pre-insulated flexible pipe systems - Part 2: Bonded plastic service pipes - Requirements and test methods; German version EN 15632-2:2010+A1:2014

DIN EN 253:2015-12

District heating pipes - Preinsulated bonded pipe systems for directly buried hot water networks - Pipe assembly of steel service pipe, polyurethane thermal insulation and outer casing of polyethylene; German version EN 253:2009+A2:2015

3 Test Specimen

- Preinsulated pipe: Type CALPEX NBA-PUR, pipe NBA 09.B
- Service pipe: PEX
- Casing pipe: LLDPE
- Foam system: PUR
- Delivery of the sample material to IMA Dresden: 2017-03-23
- Storage of the sample material before preparation and test: 72 h at 23 ± 2 °C and 50 ± 10 % R.H.

4 Testing procedure and results

Test parameter	Test value (average value)	Requirement EN 15632
Closed cell content [%]	99,5	-
Foam density [kg/m ³]	53,4	-
Water absorption [%]	4,4	≤ 10
Thermal conductivity in unaged condition [W/(m*K)]	0,0199	-

5 Summary

The test results documented in this test report verify that the tested characteristics mentioned in clause 1 of the preinsulated flexible pipe Ø 63/126 mm, type CALPEX NBA-PUR, pipe NBA 09.B, meet the requirements of DIN EN 15632 and DIN EN 253.

Reviewed

Created

Dipl.-Ing. Heiko Below
Laboratory for Pipe System Testing

Dipl.-Ing. Matthias Thölert
Person in Charge

Test Report

“Test of preinsulated flexible pipe Type CALPEX NBA-PUR, pipe NBA 09.B Manufacturer: Brugg Rohrsystem AG“

Short Title: CALPEX-NBA 09.B



Deutsche
Akkreditierungsstelle
D-PL-13119-02-00

Test Report No.: V109/17.4

Order No.: 402307040

Issued by Department Pipe Systems

Laboratory for Pipe System Testing

Recognised test laboratory of DVGW, DIN CERTCO and DIBt

The recognitions are valid for the test methods stated in the attachments of certificates of approval
DVGW LW-BU0023, DIN CERTCO PL121 and DIBt SAC 08

Pipe systems for the future

Heating systems – Industry – Petrol stations – System packages



Your partner for pipe systems

We are the people you should talk to when you need to find efficient solutions for transporting liquids. With our project engineers, development department, in-house production unit and our professional team of fitters, we have the know-how and the resources to look after your projects competently and reliably. For all types of heating systems, petrol station construction, industrial plant construction and system packages.

International network

Our global partnership network can be reached on site at any time. More than 34 partners in 20 different countries will look after you wherever you are.

Customer-specific solutions

Brugg is the full service provider in the field of single-wall, double-wall and insulated pipe systems. This know-how allows us to manufacture project-specific customised items.

Give us a call!

Our engineers would be pleased to advise you and find a made-to-measure solution.

Brugg Rohrsystem AG

Industriestrasse 39
CH-5314 Kleindöttingen
phone +41 (0)56 268 78 78
fax +41 (0)56 268 78 79
pipesystems@brugg.com
www.pipesystems.com

Brugg Pipesystems UK Ltd

3 Kelvin Road, Manor Trading Estate,
Benfleet, Essex. SS7 4QB
phone +44 (0)1268 759567
fax +44 (0)1268 569932
sales.bpuk@brugg.com
www.bruggpipesystems.co.uk

A company of the BRUGG Group